
Important Design Parameters

Allowances must be made for air venting. The under slung compressor must have an unrestricted air flow. Proper venting must be provided ensuring cool air from the room can be drawn in through the condensing coil and out the other side.

Warning

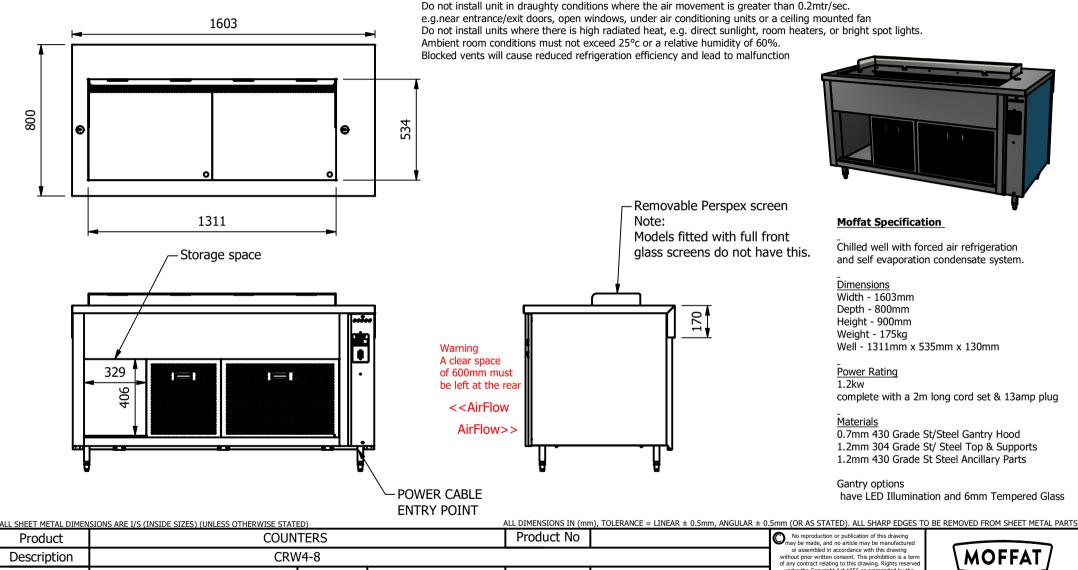

| Description | | | | | of any contract relating to this drawing. Rights reserved | | | | |
|---|-----------|-------------|-----------|----------|---|---------------|-------|-----|-----|
| Material/Finish | Thickness | | Desp/Date | | under the Copyright Act 1956 as ammended by the Design Copyright Act 1968. | | | | |
| Legacy P/N | Weight | 175kg | Quote No. | | Dwg No. | CTRP-117366-1 | | Iss | sue |
| Client | | SO Number | N/A | Drawn By | A | ABB | | | |
| Client Project | | Approved By | | Date | 28/06/2021 | | | | |
| E & R MOFFAT LTD, SEABEGS ROAD, BONNYBRIDGE, FK4 2BS, T: +44 (0)1324 812272, E: sales@ermoffat.co.uk, Web: www.ermoffat.co.uk | | | | | Scale | 1:20 | Sheet | 1/2 | A4 |